


Burner flame controls


Landis & Gyr relay



Voltage 220 - 240 V / 50 Hz. Scale 187 - 264 V.
Temperature -20 - +60 °C

R+M Nr.	safety time	TYP
842 25	10 s	LOA 24

Danfoss relay



Voltage 220 - 240 V / 50 Hz. Scale 195 - 252 V.
Temperature -20 - +60 °C

R+M Nr.	safety time	TYP
840 14	10 s	BHO 72.10

Important

In case of using the series BHO 70 together with BHA 11/12 the new LDS has to be connected with the terminals 11 (blue) and 12 (black) of the BHA 11/12.

In case of replacing the series BHO 70 by BHO 64 which is already used with BHA 11/12 it is essential to choose the version of BHA 11/12 (1 October 2006) at which terminal 11 is added.

An alternative is to exchange the old Danfoss base part.

Socle Danfoss / Landis & Gyr



Socle with 12 connections

R+M Nr.
840 18



Front plate for socle

R+M Nr.
840 17

Photocell Danfoss / Landis & Gyr



LDS 037H7057 with cable

R+M Nr.
840 19



Flange photocell

R+M Nr.
840 21




Tension ring

R+M Nr.
840 22

Coils

Suitable for Sirio

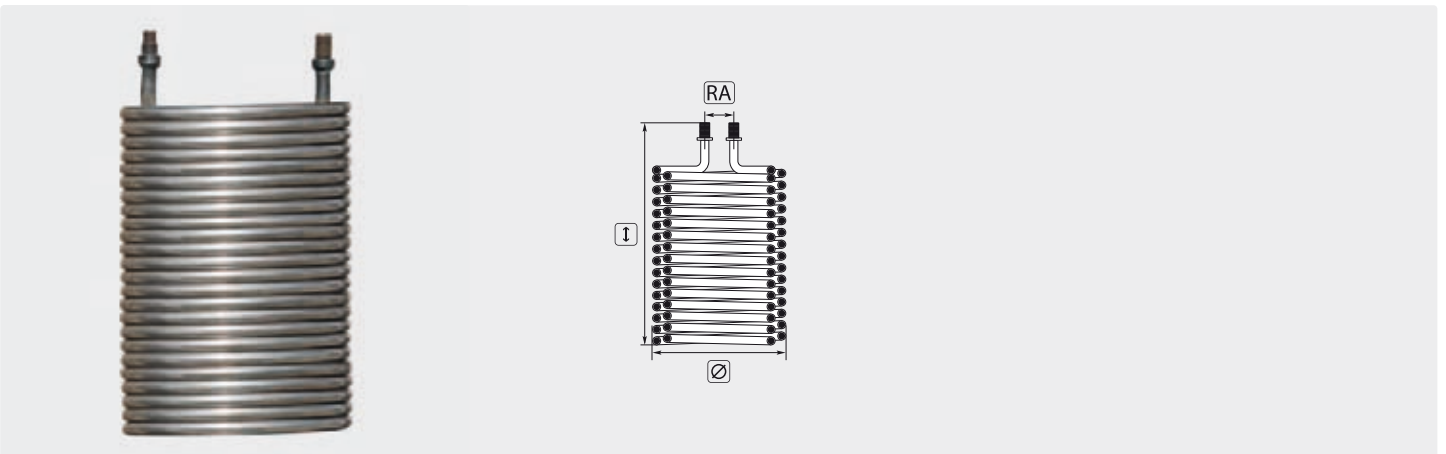

R+M Nr.	Suitable for hp cleaner	I	Ø	RA	RØ
200 080 645	SKIPPER	550	280	215	17
200 080 640	MATCH BALL	460	280	215	17